



Intellect

Forteza Integration Module Settings Guide

1. List of terms used in Forteza integration module Settings guide	3
2. Introduction into Forteza integration module Settings guide	3
3. Configuring Forteza integration module	3
3.1 Forteza integration module set up procedure	3
3.2 Activation of Forteza integration module	3
3.3 Automatic creation of the object tree in Forteza PID	4
3.4 Configuring Forteza base sensor	5
3.5 Configuring Forteza one-position sensor	6
3.5.1 Configuring area of Forteza one-position sensor	6
3.6 Configuring Forteza two-position sensor	7
3.7 Configuring Fort-K relay	8
3.8 Configuring LED spotlight	9
4. Working with Forteza PID integration module	10
4.1 General information about working with Forteza integration module	10
4.2 Controlling Forteza base sensor	11
4.3 Controlling Forteza one-position sensor	11
4.4 Controlling Forteza two-position sensor	11

List of terms used in Forteza integration module Settings guide

Perimeter Intrusion Detection System (PID) is a hardware-software system used to control perimeter violation.

Intellect Server is a computer with installed *Intellect* software (**Server** configuration).

Forteza sensors are annunciators used to secure premises and perimeter zones (depending on the type of a connected sensor) and to notify about alarm when a violator enters the area.

Zebra sensor is a single-ended radio-wave annunciator used to secure perimeter zones, outdoor and indoor sites, storage facilities, tunnels, viaducts and to notify about alarm when a violator enters the area.

Introduction into Forteza integration module Settings guide

On the page:

- [Purpose of document](#)
- [General information about Forteza integration module](#)

Purpose of document

The *Forteza integration module Settings guide* is a reference guide for users of the *Forteza* module that is a part of *ACFA Intellect* software package.

The guide provides:

1. general information about *Forteza module*;
2. information about how to configure *Forteza module*;
3. information about how to work with *Forteza module*.

General information about Forteza integration module

Forteza software module is a part of *ACFA Intellect* software package. It configures and enables interaction between *ACFA Intellect* and *Forteza PID* (manufactured by JSC "Ohrannaya Technika").



Note.

For more information about *Forteza PID*, please refer to official documentation for this system.

Before configuring *Forteza PID* integration module, do the following:

1. install *Forteza PID* hardware at the site (see vendor documentation);
2. connect *Forteza PID* to Server.

Configuring Forteza integration module


Forteza integration module set up procedure

Forteza PID integration module is configured in *ACFA Intellect* as follows:

1. [Activation of Forteza integration module](#);
2. [Automatic creation of the object tree](#)
3. [Configuration of Forteza sensors](#).

Activation of Forteza integration module

In order to activate *Forteza* integration module create a **Forteza** object under the **LOCALHOST** object in the **Hardware** tab of the **System settings** dialog box.

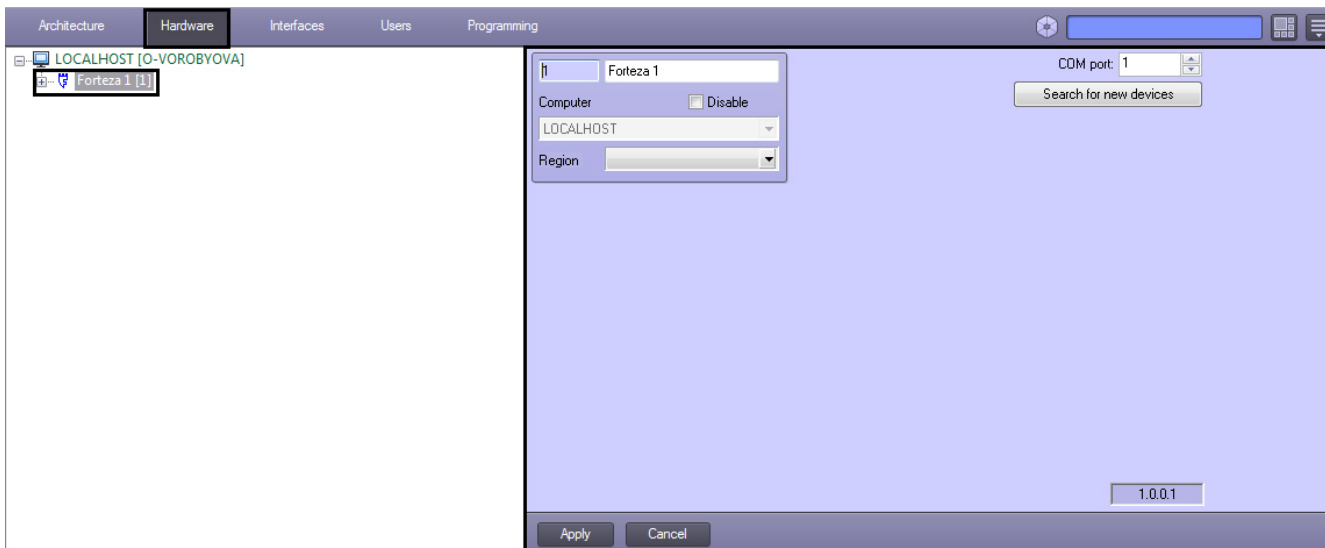

Note.
An integration module version is shown on the **Forteza** settings panel.


PID *Forteza* integration module is now activated.

Automatic creation of the object tree in Forteza PID

When the object tree is created automatically, there is the search for devices connected to the Server and corresponding objects are created under the **Forteza** object in *ACFA Intellect* object tree.


Automatically create the object tree as follows:

1. Go to the **Forteza** object settings panel.

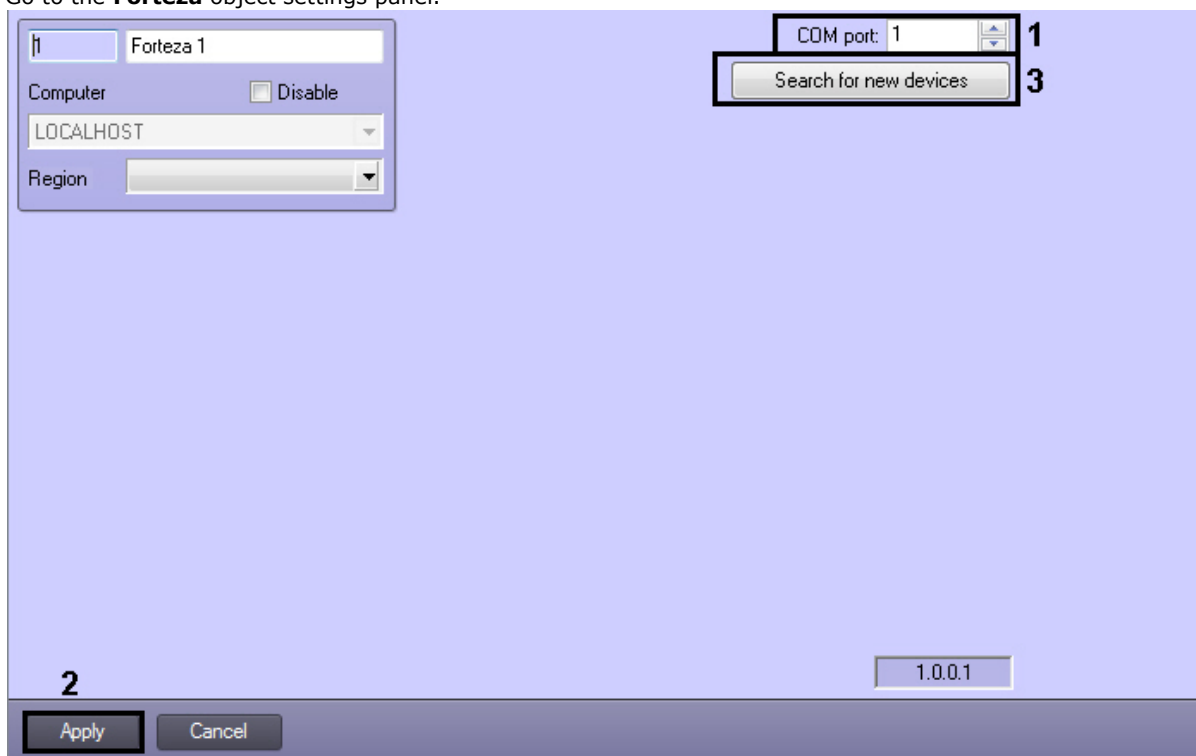

2. In the **COM port** field specify the number of port to connect *Forteza PID* to the Server (**1**).
3. Click the **Apply** button (**2**).
4. Click the **Search for new devices** button for automatic creation of the object tree (**3**).


As a result the object tree is created.

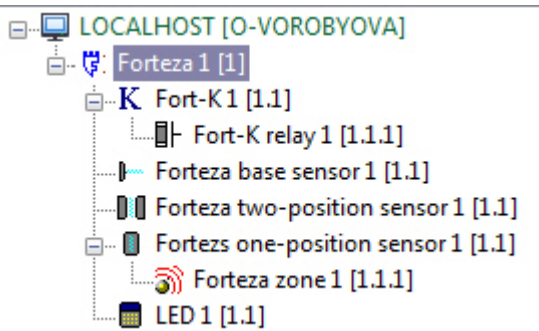

Automatic creation of the object tree is completed.


Configuring Forteza base sensor

In *ACFA Intellect* the *Forteza* base sensor is configured on the settings panel of the **Forteza sensor** object. This object is created under the **Forteza** object in the **Hardware** tab of the **System settings** dialog box.

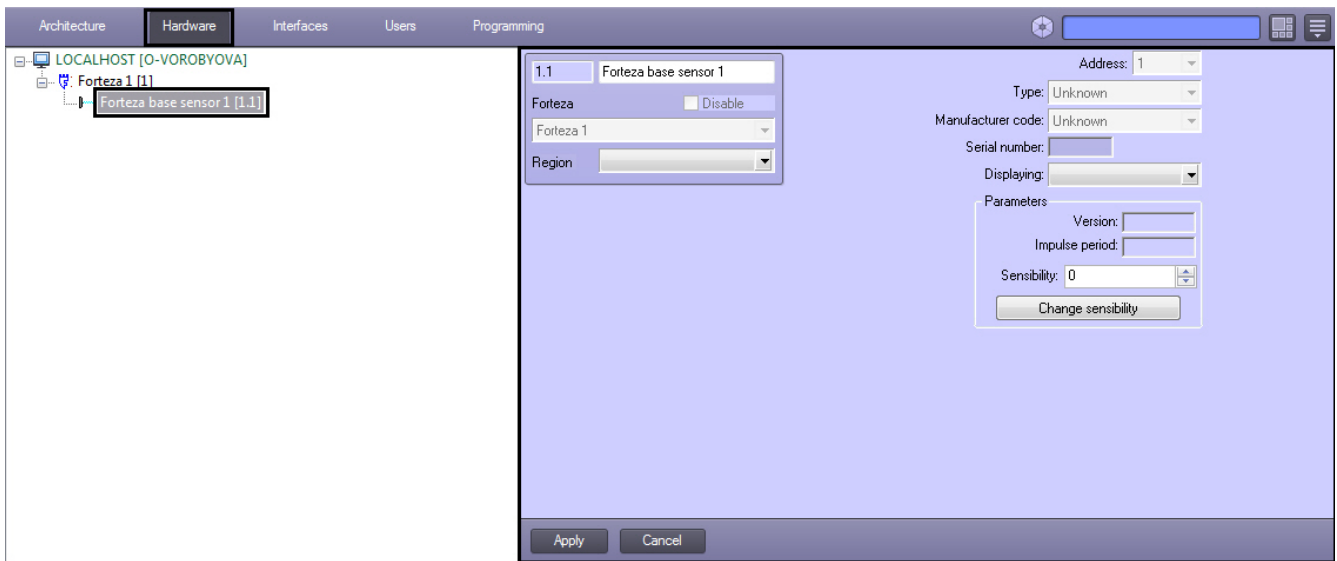

Configure *Forteza* base sensor as follows:

1. Go to the settings panel of the **Forteza base sensor** object.

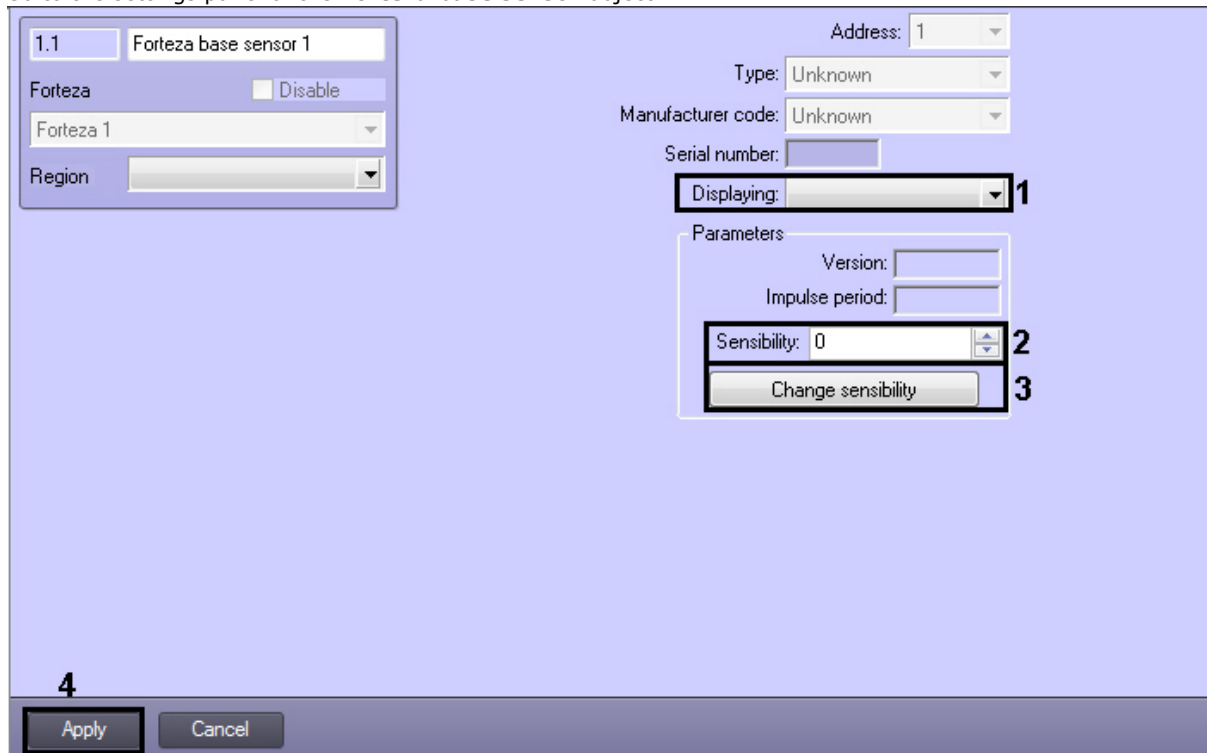

2. From the **Displaying** drop-down list select set of icons corresponding to base sensor (1).
3. In the **Sensibility** field specify level of sensor sensibility (2).
4. Click the **Change sensibility** button (3).
5. Click the **Apply** button to save changes (4).

Forteza base sensor is configured.


Configuring Forteza one-position sensor

In *ACFA Intellect* the *Forteza* one-position sensor is configured on the settings panel of the **Forteza one-position sensor** object. This object is created under the **Forteza** object in the **Hardware** tab of the **System settings** dialog box.



Configure *Forteza* one-position sensor as follows:

1. Go to the settings panel of the **Forteza one-position sensor** object.

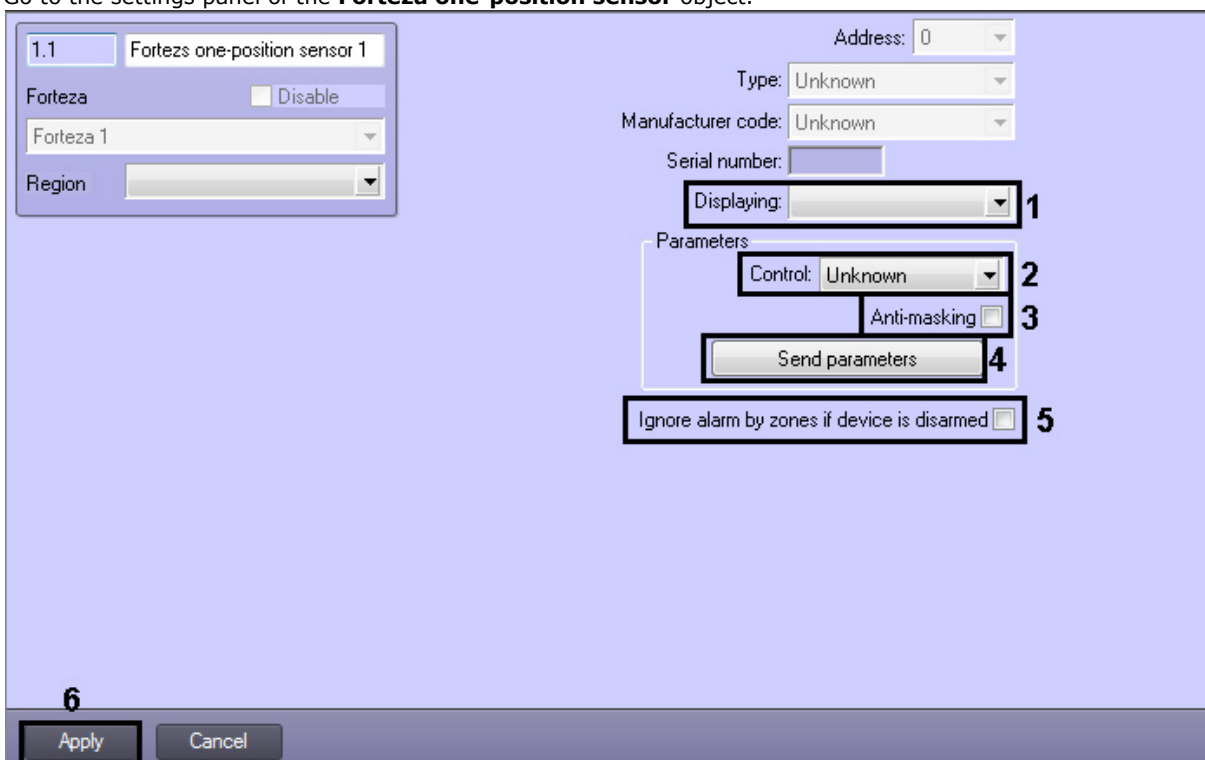


2. From the **Displaying** drop-down list select set of icons corresponding to one-position sensor (1).
3. From the **Control** drop-down list select the way of sensor control. It's possible to control sensor independently or using a computer (2).
4. If an alarm event is to be generated in the system when an attempt to cover sensor with reflecting layer is detected, set the **Anti-masking** checkbox checked (3).
5. To send parameters to device click the **Send parameters** button (4).
6. If it's required to ignore alarm events when device is disarmed, set the corresponding checkbox (5).
7. Click the **Apply** button to save changes (6).

Forteza one-position sensor is configured.

Configuring area of Forteza one-position sensor


In *ACFA Intellect* the area of the *Forteza* one-position sensor is configured on the settings panel of the **Forteza zone** object. This object is created under the **Forteza one-position** object in the **Hardware** tab of the **System settings** dialog box.

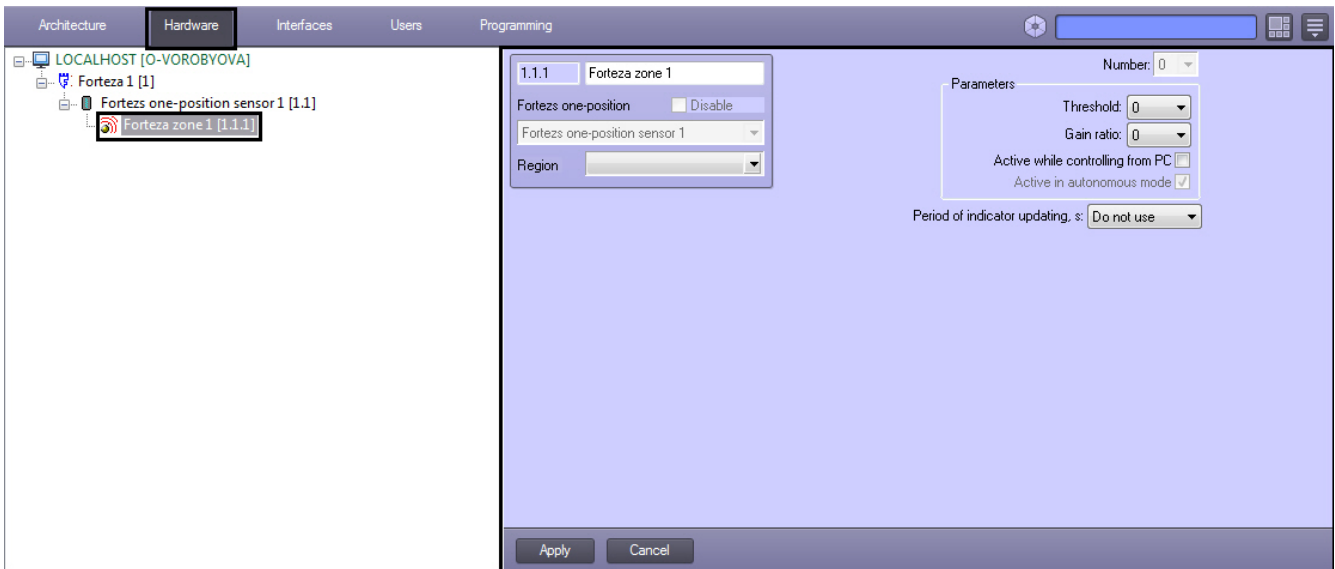

Note.
Forteza one-position sensor supports 12 areas.

Configure area of *Forteza* one-position sensor as follows:

1. Go to the settings panel of the **Forteza zone** object.

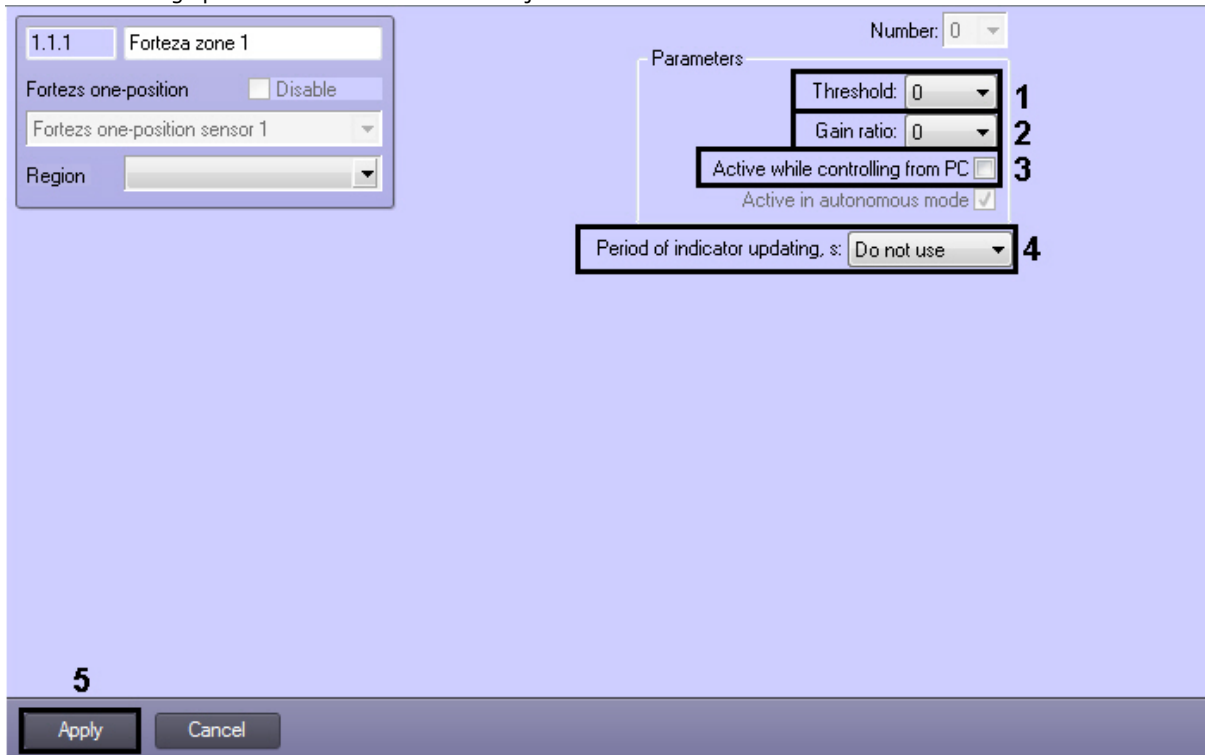


2. From the **Threshold:** drop-down list select value of sensibility threshold (1). The minimum sensitivity of the sensor corresponds to the maximum value of the **Threshold** parameter, i.e. the bigger the value of this parameter, it is more probable that alarm event will be skipped.
3. From the **Gain ratio:** drop-down list select value of area sensor signal gain (2).
4. If it's required to receive events from the area while controlling from PC set the corresponding checkbox (3).
5. Specify the period of indicator updating in seconds (4). Select the **Do not use** value if updating is not required.
6. To save changes click the **Apply** button (5).

Area of *Forteza* one-position sensor is configured.


Configuring Forteza two-position sensor

In *ACFA Intellect* the *Forteza* two-position sensor is configured on the settings panel of the **Forteza two-position sensor** object. This object is created under the **Forteza** object in the **Hardware** tab of the **System settings** dialog box.

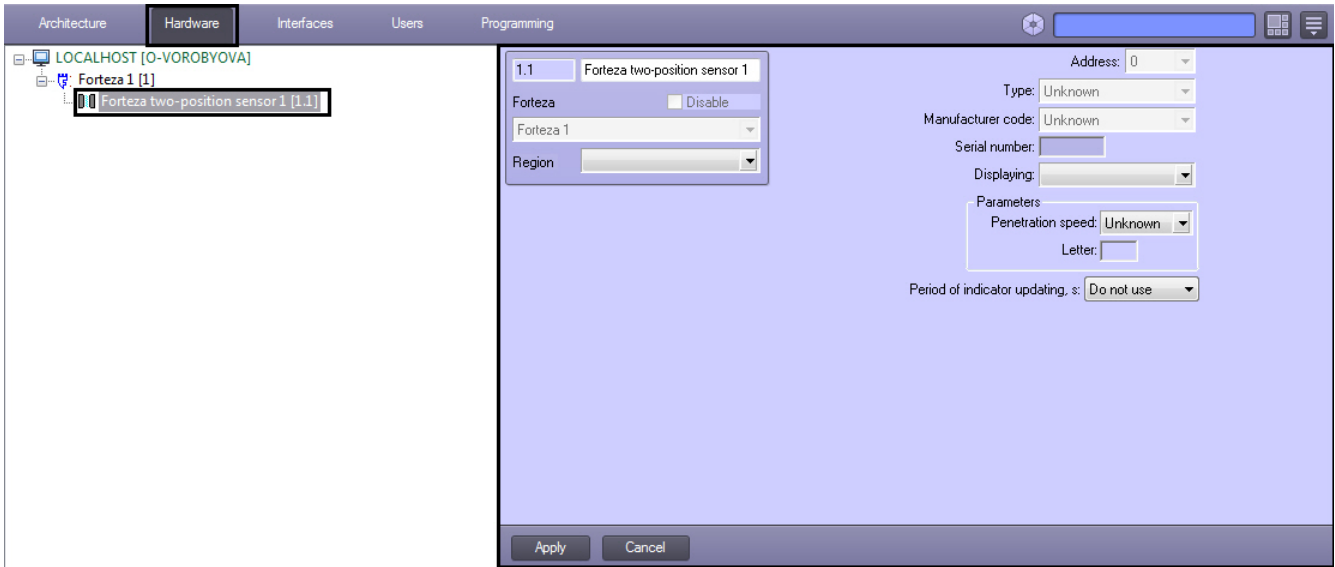

Configure *Forteza* two-position sensor as follows:

1. Go to the settings panel of the **Forteza two-position sensor** object.

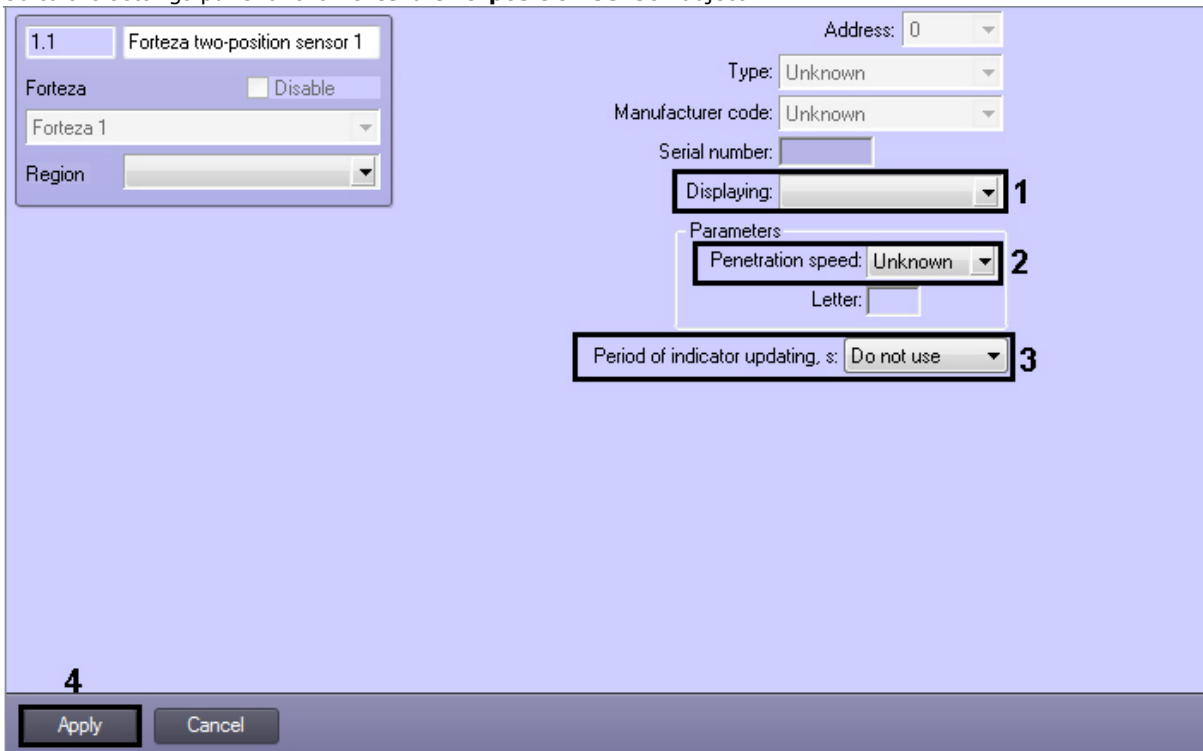


2. From the **Displaying** drop-down list select set of icons corresponding to two-position sensor (1).
3. From the **Penetration speed** drop-down list select speed of penetration to the secured zone (2).
4. Specify the period of indicator updating in seconds (3). Select the **Do not use** value if updating is not required.
5. To save changes click the **Apply** button (4).

Forteza two-position sensor is configured.


Configuring Fort-K relay

In *ACFA Intellect* the *Fort-K* relay is configured on the settings panel of the **Fort-K relay** object. This object is created under the **Fort-K** object in the **Hardware** tab of the **System settings** dialog box.

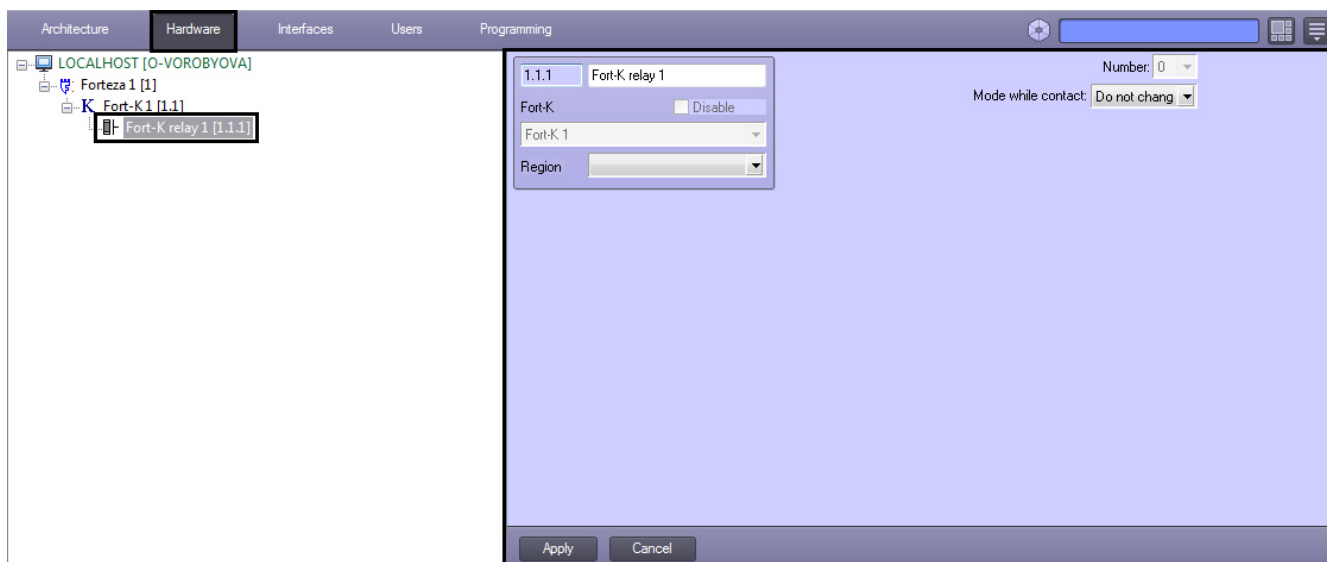

Configure *Fort-K* relay as follows:

1. Go to the settings panel of the **Fort-K relay** object.

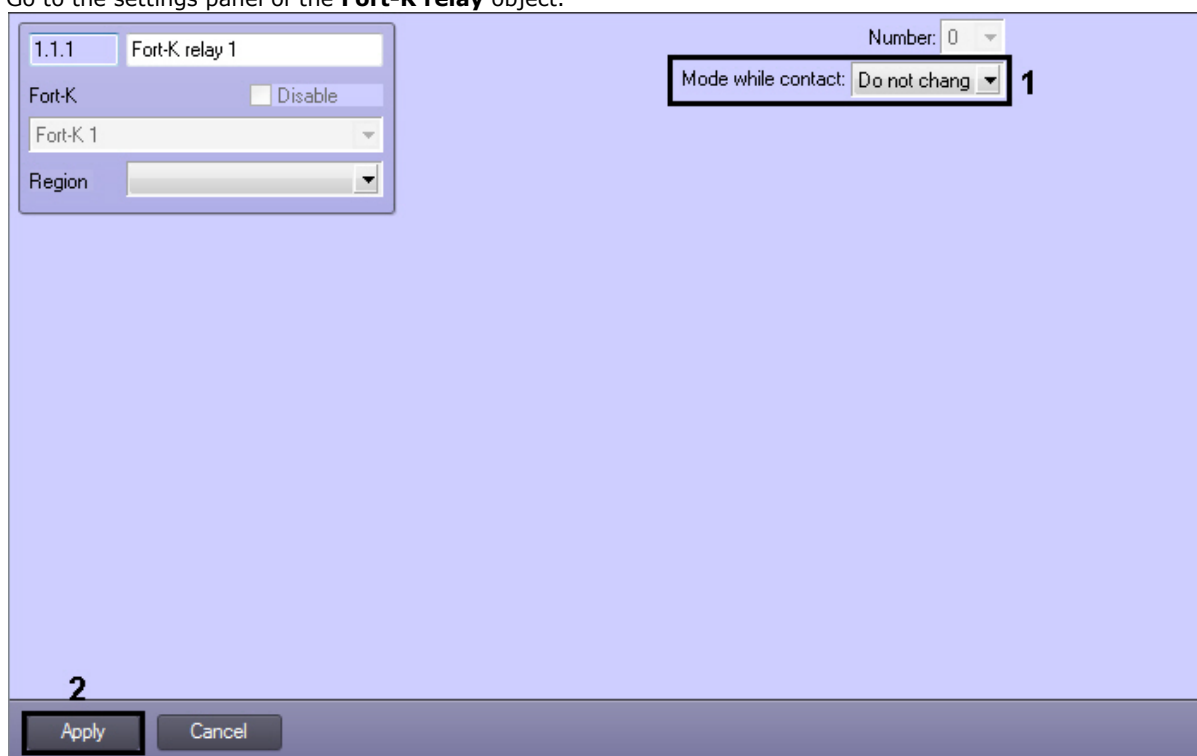


2. From the **Mode while contact:** drop-down list select the mode of relay operation (**1**):
 - a. Do not change – mode of relay is not changed while connection to device.
 - b. Enabled – relay is enabled while connection to device.
 - c. Disabled – relay is disabled while connection to device.
3. To save changes click the **Apply** button (**2**).

Fort-K relay is configured.


Configuring LED spotlight

In *ACFA Intellect* the LED spotlight is configured on the settings panel of the **LED** object. This object is created under the **Forteza** object in the **Hardware** tab of the **System settings** dialog box.

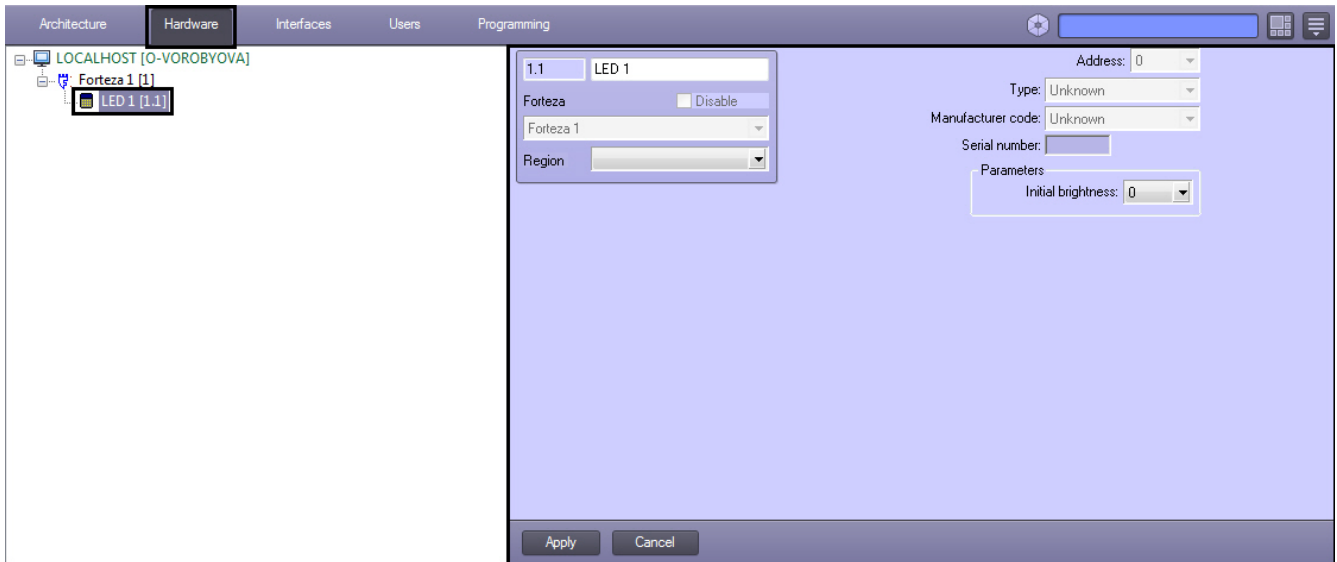

Configure LED spotlight as follows:

1. Go to the settings panel of the **LED** object.

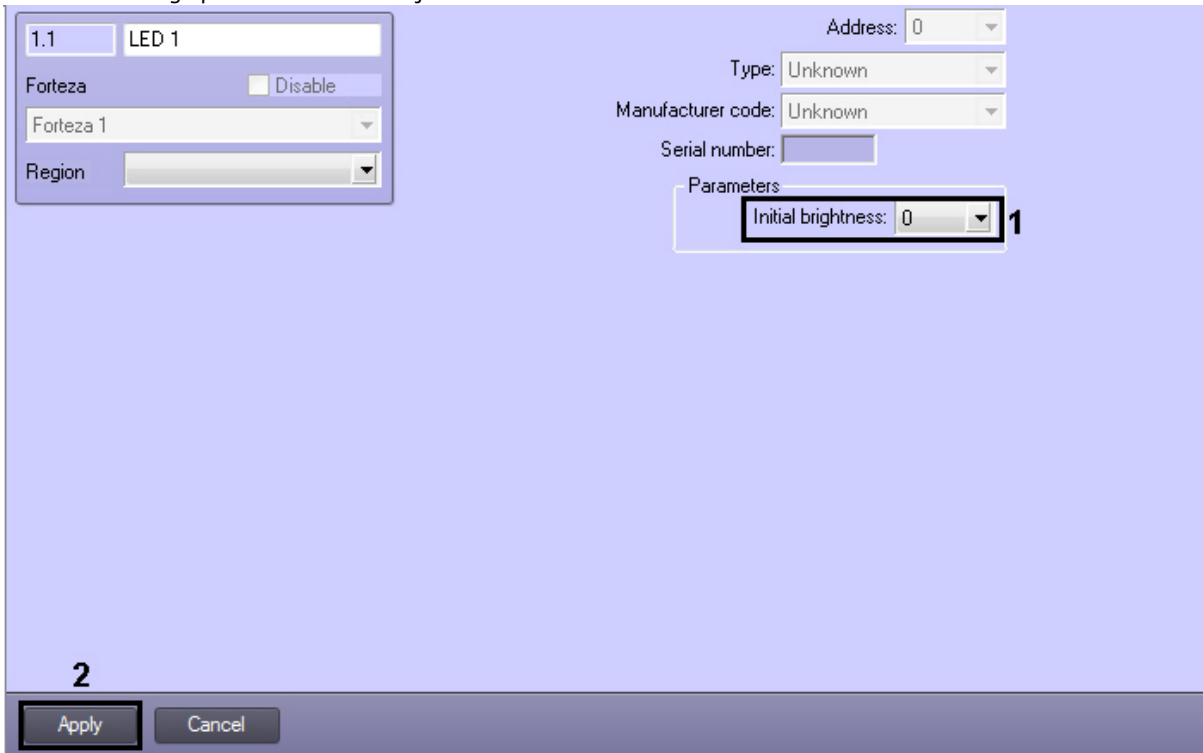

2. From the **Initial brightness** drop-down list select the value from 0 to 255 corresponding to initial brightness of LED spotlight (1).
3. Click **Apply** button to save changes (2).

LED spotlight is configured.

Working with Forteza PID integration module

General information about working with Forteza integration module

The following interface objects are used for working with *Forteza PSS* integration module:


1. **Map**;
2. **Event Viewer**.

Information on how to configure these interface objects is given in details in [Intellect Software package: Administrator's Guide](#).

Information on how to work with interface objects is given in details in [Intellect Software package: Operator's Guide](#).

Controlling Forteza base sensor

Forteza base sensor is controlled in the **Map** interactive box using the function menu of the **Forteza base sensor** object.

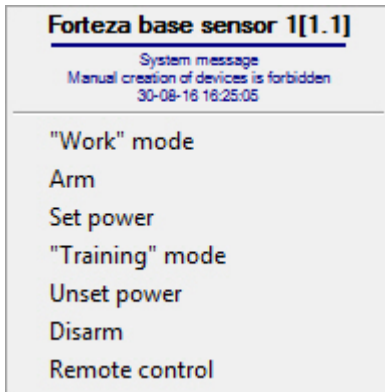


Find description of function menu commands of the **Forteza base sensor** objects in the table.

Function menu command	Executed function
"Work" mode	Switches sensor to the working mode
Arm	Arms sensor
Set power	Sets power to active element
"Training" mode	Switches sensor to the training mode
Unset power	Unsets power from active element
Disarm	Disarms sensor
Remote control	Enables remote control of sensor

Controlling Forteza one-position sensor

Forteza one-position sensor is controlled in the **Map** interactive box using the function menu of the **Forteza one-position sensor** object.

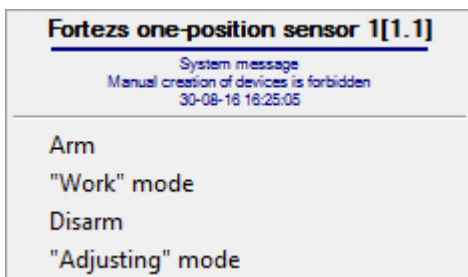

Find description of function menu commands of the **Forteza one-position sensor** objects in the table.

Function menu command	Executed function
Arm	Arms sensor
"Work" mode	Switches sensor to the working mode
Disarm	Disarms sensor
"Adjusting" mode	Switches sensor to the configuration mode

Controlling Forteza two-position sensor

Forteza two-position sensor is controlled in the **Map** interactive box using the function menu of the **Forteza two-position sensor** object.

Forteza two-position sensor 1[1.1]

System message
Manual creation of devices is forbidden
30-08-16 16:25:05

Mode
Arm
Disarm
Threshold

Find description of function menu commands of the **Forteza one-position sensor** objects in the table.

Function menu command	Executed function
Mode	Switches sensor to the mode of threshold configuring
Arm	Arms sensor
Disarm	Disarms sensor
Threshold	Sets operation threshold