



# Guide for configuring and working with the CORTEX WinSC integration module

ACFA PSIM 1.3.1

Last update 16/05/2025

## Table of Contents

<b>1 Introduction into the Guide for configuring and working with the CORTEX WinSC integration module .....</b>	<b>3</b>
1.1 Purpose of the document .....	3
1.2 General information about the CORTEX WinSC integration module .....	3
<b>2 Supported software and licensing of the CORTEX WinSC module .....</b>	<b>4</b>
<b>3 Configuring the CORTEX WinSC integration module .....</b>	<b>5</b>
3.1 Configuring the parent object of the CORTEX WinSC integration module .....	5
3.2 Configuring the object of the CORTEX WinSC integration module .....	6
3.3 Configuring the output of the CORTEX WinSc integration module .....	7
3.4 Configuring the zone of the CORTEX WinSC integration module .....	7
<b>4 Working with the CORTEX WinSC integration module .....</b>	<b>9</b>
4.1 General information about working with the CORTEX WinSC integration module .....	9
4.2 Managing the parent object and zone of the CORTEX WinSC integration module .....	9
4.3 Managing the object of the CORTEX WinSC integration module .....	9
4.4 Managing the output of the CORTEX WinSC integration module .....	10
4.5 Example of a configured macro of the CORTEX WinSC integration module .....	10

# 1 Introduction into the Guide for configuring and working with the CORTEX WinSC integration module

## On the page:

- [Purpose of the document](#)
- [General information about the CORTEX WinSC integration module](#)

## 1.1 Purpose of the document

The *Guide for configuring and working with the CORTEX WinSC integration module* is a reference and information manual and is intended for configuration specialists of the *CORTEX WinSC* integration module. This module is a part of the fire and security alarm (FSA) subsystem implemented on the basis of *ACFA PSIM*.

The Guide has the following information:

1. General information about the *CORTEX WinSC* integration module.
2. Configuring the *CORTEX WinSC* integration module.
3. Working with the *CORTEX WinSC* integration module.

## 1.2 General information about the CORTEX WinSC integration module

The *CORTEX WinSC* integration module is a part of the FSA implemented on the basis of *ACFA PSIM* and is used to perform the following functions:

1. Configuration of the *CORTEX WinSC* controller (manufactured by the *KORTEKS* company).
2. Providing interaction of the *CORTEX WinSC* controller with *ACFA PSIM* (monitoring, control).

### Note

For detailed information about the *CORTEX WinSC* FSA, refer to the official reference documentation for this system.

Before configuring the *CORTEX WinSC* integration module, do the following:

1. Install the *CORTEX WinSC* hardware on the protected facility (see the official *CORTEX* reference documentation).
2. Connect the *CORTEX WinSC* controller to the *Axxon PSIM* server (see the official *CORTEX* reference documentation).

## 2 Supported software and licensing of the CORTEX WinSC module

<b>Manufacturer</b>	KORTEKS, SIA Address: Liksnas street 7, Riga, LV-1003, Latvia Phone: +371 67 505 603 Fax: +371 67 505 604 Email: <a href="mailto:support@cortex.lv">support@cortex.lv</a> Website: <a href="http://cortex.eu/">http://cortex.eu/</a>
<b>Type of integration</b>	SOFT-SOFT

### Supported software

Software	Function
CORTEX Security Commander for Windows v5.xx	Monitoring of fire and security alarm system in Windows OS

### Module licensing

Per each zone as ACFA sensor.


## 3 Configuring the CORTEX WinSC integration module

### 3.1 Configuring the parent object of the CORTEX WinSC integration module


To work with the *CORTEX WinSC* integration module, you must install and configure the *AxACFA* feature. For more details, see [Connecting and configuring the AxACFA feature](#).

To configure the *CORTEX WinSC* parent object, do the following:

1. Create the **CORTEX WinSC** parent object on the basis of the **Axacfa** object on the **Hardware** tab of the **System settings** window.
2. On the settings panel of the **CORTEX WinSC** object in the **Address** field, specify the IP address of the computer to connect the *CORTEX Security Commander* manufacturer's software to the *PSIM* server.

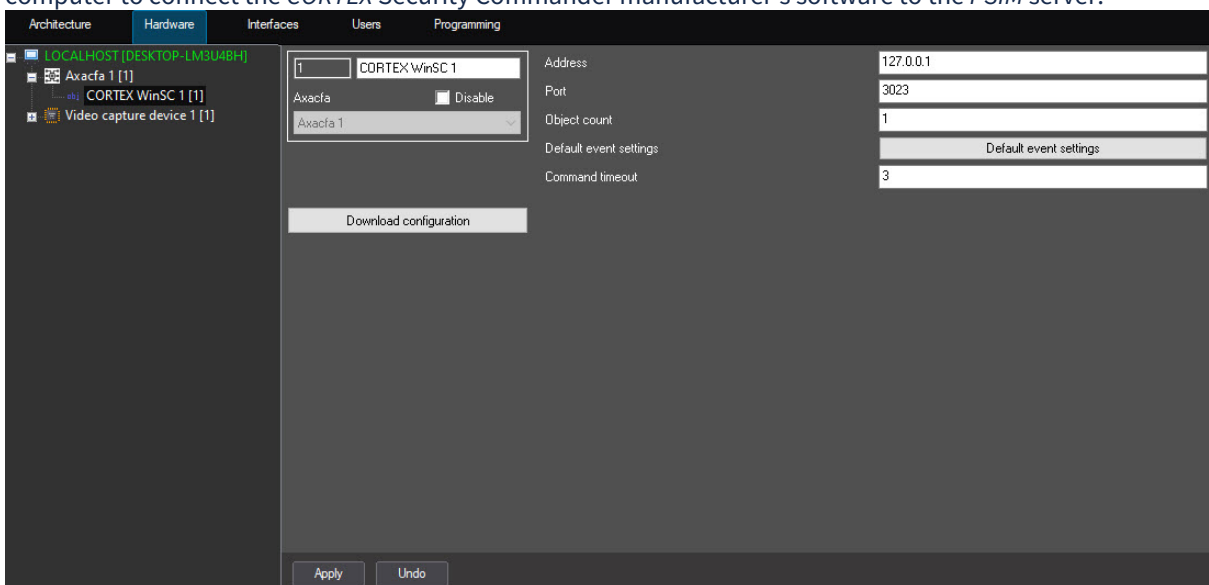


3. In the **Port** field, specify the number of the port to connect the *CORTEX Security Commander* manufacturer's software to the *PSIM* server.
4. In the **Object count** field, specify the number of the objects created in the system when downloading the configuration. The default value is **1**.
5. Click the **Default event settings** button to change default events (events are used from the *CORTEX Security Commander* manufacturer's software).

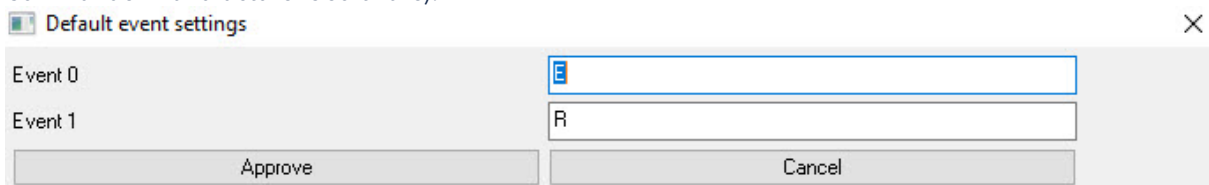

6. In the **Command timeout** field, specify in seconds the period during which the *CORTEX* controller waits for commands.
7. Click the **Apply** button to save the changes.

- Click the **Download configuration** button to download the configuration and automatically build the hardware tree:




Configuration of the *CORTEX WinSC* parent object is complete.

## 3.2 Configuring the object of the CORTEX WinSC integration module


To configure the object of the *CORTEX WinSC* integration module, do the following:

- Go to the settings panel of the **CORTEX Object** that is created on the basis of the **CORTEX WinSC** parent object after you download the configuration (see [Configuring the CORTEX WinSC parent object](#)).

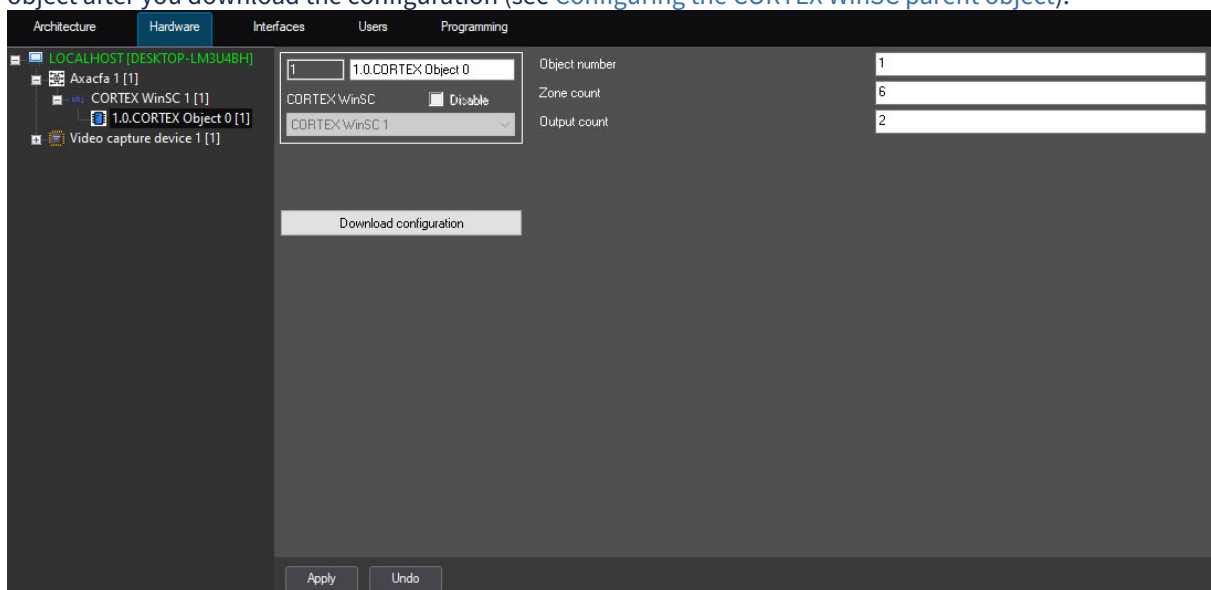

- In the **Object number** field, specify the object number in the system.
- In the **Zone count** field, specify the number of zones created on the basis of this object when downloading the configuration.
- In the **Output count** field, specify the number of outputs created on the basis of this object when downloading the configuration.
- Click the **Apply** button to save the settings.

- Click the **Download configuration** button to download the configuration and automatically build the hardware tree:

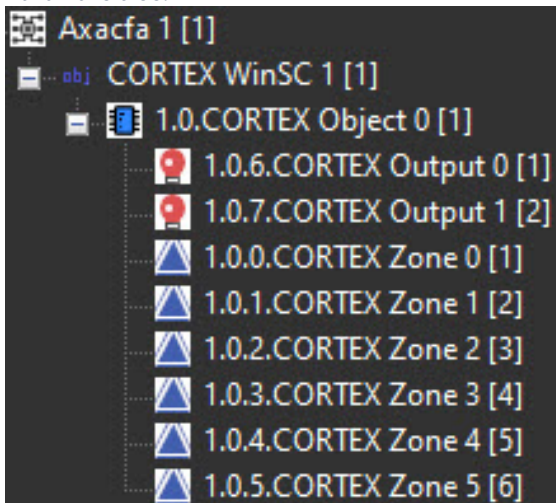


Configuration of the object of the *CORTEX WinSC* integration module is complete.

### 3.3 Configuring the output of the CORTEX WinSc integration module

To configure the output of the *CORTEX WinSC* integration module, do the following:

- Go to the settings panel of the **CORTEX Output** object that is created on the basis of the **CORTEX Object** after you download the configuration (see [Configuring the object of the CORTEX WinSC integration module](#)).

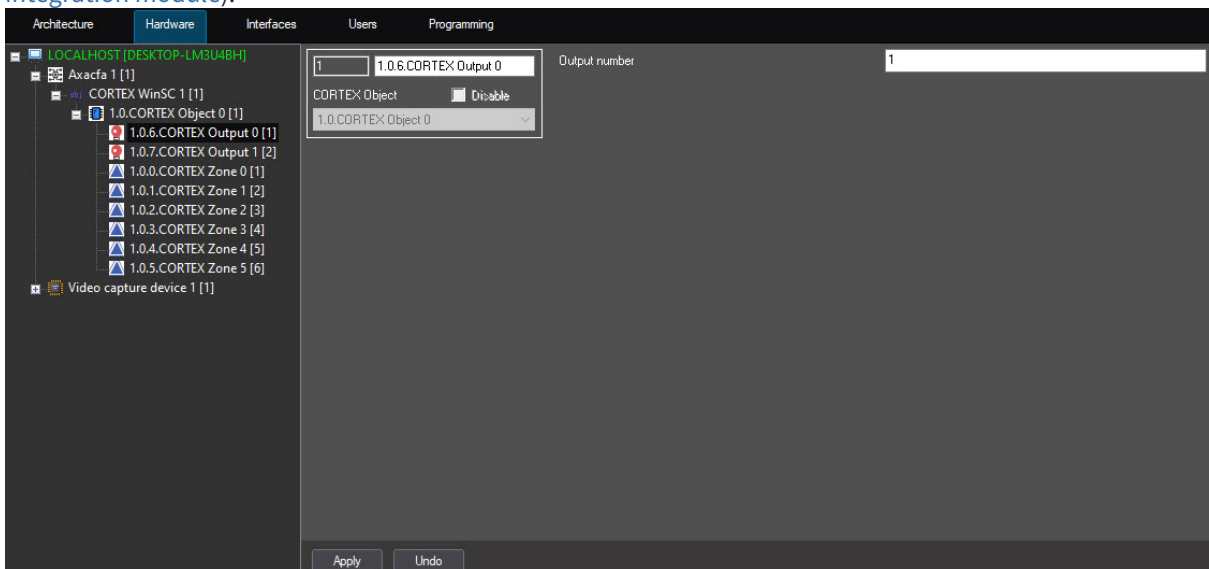


- In the **Output number** field, specify the output number in the system.
- Click the **Apply** button to save the settings.

Configuration of the output of the *CORTEX WinSC* integration module is complete.


### 3.4 Configuring the zone of the CORTEX WinSC integration module

To configure the zone of the *CORTEX WinSC* integration module, do the following:

1. Go to the settings panel of the **CORTEX Zone** object that is created on the basis of the **CORTEX Object** after you download the configuration (see [Configuring the object of the CORTEX WinSC integration module](#)).

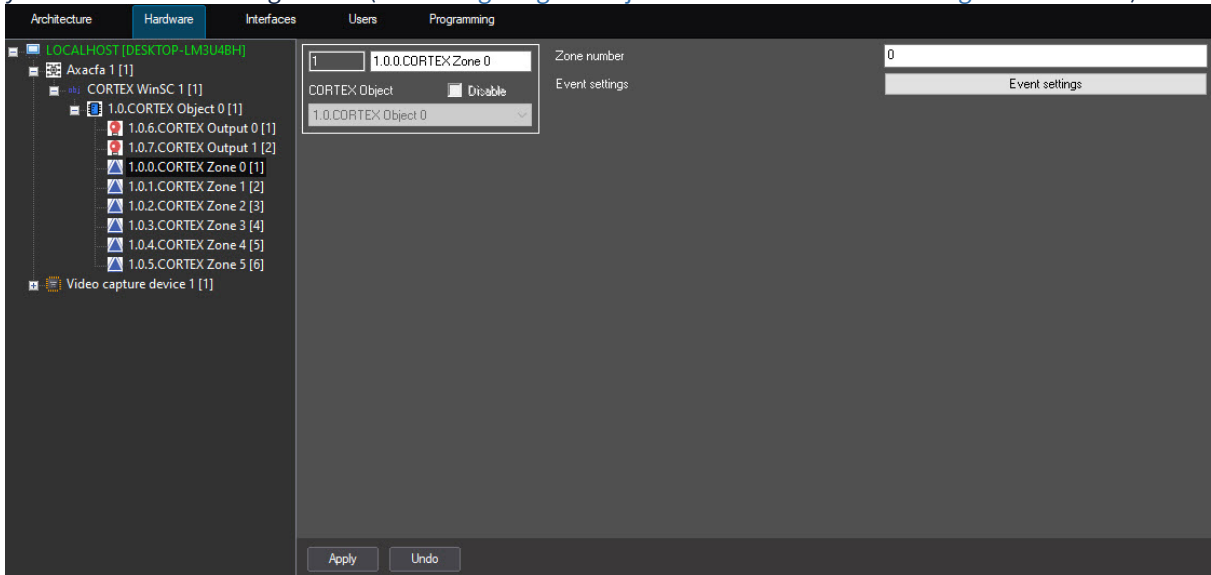

2. In the **Zone number** field, specify the zone number in the system.
3. Click the **Event settings** button.
  - a. In the window that opens, specify events for this zone. Events are specified from the CORTEX Security Commander manufacturer's software.

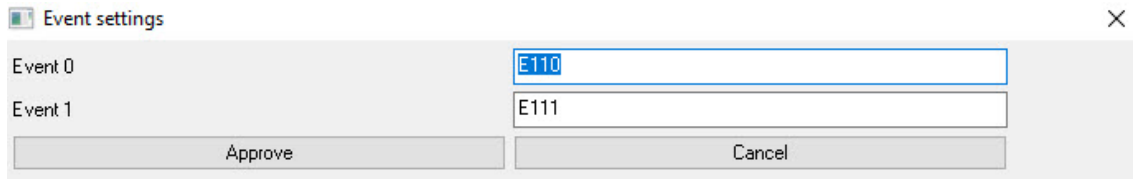

- b. Click the **Approve** button to save the settings.
4. Click the **Apply** button.

Configuration of the zone of the *CORTEX WinSC* integration module is complete.

## 4 Working with the CORTEX WinSC integration module

### 4.1 General information about working with the CORTEX WinSC integration module

To work with the *CORTEX WinSC* integration module, use the following interface objects:

1. **Map.**
2. **Event Viewer.**




For the information on configuring these interface objects, see the *Axxon PSIM Administrator's Guide*.

For the information on working with these interface objects, see the *Axxon PSIM Operator's Guide*.

### 4.2 Managing the parent object and zone of the CORTEX WinSC integration module

You cannot manage the parent object and zone of the *CORTEX WinSC* integration module in the **Map** window.

The parent object and zone of the *CORTEX WinSC* integration module can have the following states:

	Unknown
	Connection established
	Connection lost




### 4.3 Managing the object of the CORTEX WinSC integration module

You can manage the object of the *CORTEX WinSC* integration module in the **Map** window using the menu of the corresponding object.

Commands to manage the object of the *CORTEX WinSC* integration module are described in the table:

Menu command	Function
STAY arming	Leave the <i>CORTEX WinSC</i> object armed
AWAY arming	Arm the <i>CORTEX WinSC</i> object
Disarming	Disarm the <i>CORTEX WinSC</i> object

The *CORTEX WinSC* object can have the following states:

	Unknown
	Connection established
	Connection lost




## 4.4 Managing the output of the CORTEX WinSC integration module

You can manage the output of the *CORTEX WinSC* integration module in the **Map** window using the menu of the corresponding object.


Commands to manage the output of the *CORTEX WinSC* integration module are described in the table:

Menu command	Function
Turn output on	Turn on the <i>CORTEX WinSC</i> output
Turn output off	Turn off the <i>CORTEX WinSC</i> output

The *CORTEX WinSC* output can have the following states:

	Unknown
	Connection established
	Connection lost

## 4.5 Example of a configured macro of the CORTEX WinSC integration module

-  [Creating and using macros](#)  
[Examples of macros](#)

When working with the *CORTEX WinSC* integration module, you can configure a macro that triggers when an event is received from *CORTEX WinSC* devices.

Example of a configured macro:

3 Macro 3 Response sending delay (s): 5

Disable Fast call: None Icon type: Macro 1

---

Settings

State: Standard  Local  Hidden

Events				Parameters	
Type	Number	Name	Event	Name	Value
CORTEX Object 1	1	1.0.CORTEX Object 0	Command failed		

Actions				Parameters	
Type	Number	Name	Action	Name	Value
CORTEX Object	1	1.0.CORTEX Object 0	STAY arming		

Apply    Undo